


VARIFLEX SEMI-AUTOMATIC

TE-WA-switch SL

Cable plan

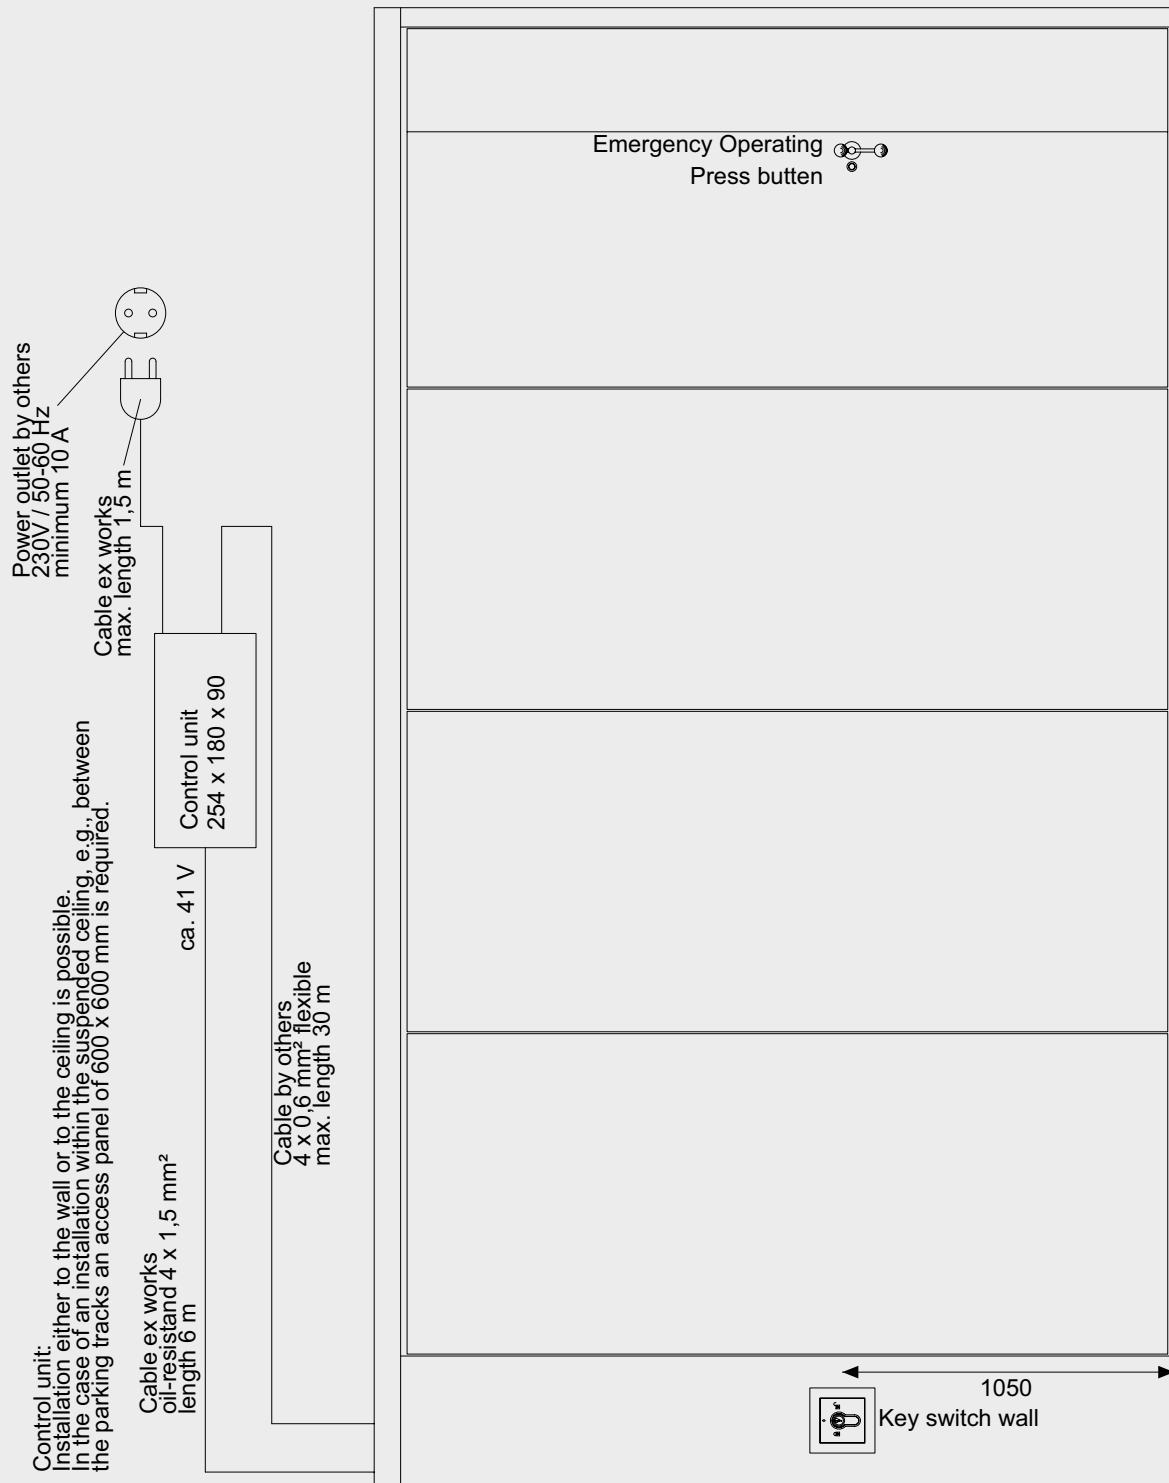

Control unit:
Installation either to the wall or to the ceiling is possible.
In the case of an installation within the suspended ceiling, e.g., between
the parking tracks an access panel of 600 x 600 mm is required.

Power outlet by others
230V / 50-60 Hz
minimum 10 A

Cable ex works
max. length 1,5 m

Cable ex works
oil-resistant 4 x 1,5 mm²
length 6 m

Control unit
254 x 180 x 90

ca. 41 V

Cable by others
4 x 0,6 mm² flexible
max. length 30 m

1050
Key switch wall

Emergency Operating
Press button